

CASE STUDY

Olift™ Foam Fractionation removes PFAS from Industrial Sewage

REMEDIATION PROJECT

**Brisbane International Airport
AFFF System Malfunction**

MATERIAL

**PFAS Contaminated Industrial
Sewer, Estuarine Water & Industrial
Cleaning Fluids**

VOLUME

**More than 4,750,000 gallons
(18,000,000 liters)**

PRINCIPAL

Airline Operator

LOCATION

Brisbane, Queensland, Australia



Olift™

**BREAK
FREE
FROM
PFAS™**

SUMMARY

Responding to an emergency request to remediate a PFAS impacted industrial sewer and surface water, An Olift™ mobile water treatment plant was rapidly deployed to resolve the complex treatment challenge. The plant was required to manage significant inlet quality fluctuation and meet strict regulatory criteria for discharge to the local municipal utility.

Upon the safe and successful completion of the client's initial scope, without variations, the project was extended to PFAS impacted industrial cleaning fluids. All project expectations were met with treated materials discharged to contract specification and extracted PFAS concentrated for off-site destruction, removing the captured PFAS from the environment permanently.

SOLUTION

Olift™, an innovative ozone foam fractionation technology (manufactured and marketed exclusively in the USA and Canada by Ovivo) reduced the PFAS into a concentrate of less than 1% of the original impacted volume. This reduction in volume conservatively saved the client an estimated \$25M in water management costs. Subsequent improvements to the process have decreased the concentrate volume to less than 0.2%.

Utilising a single Olift™ process train, the process was able to successfully remove the bulk PFAS and biological load from industrial sewer, storm water, estuarine water, caustic solvent cleaning solutions and trade waste. This allowed processing by an RO-NF final polish system to meet the project discharge objectives.

Ovivo's competitive Olift™ technology, with its whole-of-project economic benefits and minimal footprint integrated into the clients workplace, allowing the client to maintain all core operations while meeting their remediation obligations.

RESULTS

Olift™ consistently achieved treatment levels to below those of the local drinking water standards for PFAS. The average discharge quality for key PFAS compounds PFOA, PFOS and PFHxS was <0.01µg/L.

Combining Olift™ with an RO-NF polishing unit reduced the total PFAS by over 99.9%, as measured via TOP Assay. The average sum of PFAS (TOP Assay) of 762µg/L in the influent was reduced to an average sum of PFAS (TOP Assay) of <0.56µg/L in the treated discharge water across the impacted sewage.

ISSUE

Historical use of PFAS in aqueous film forming foam (AFFF), industrial surface coatings and other household products, coupled with their persistent nature and high mobility, has led to a widespread global problem. PFAS is a group of over 10,000 synthetic compounds, with current human health concerns dominated by specific compounds including PFOS, PFOA and others. Additionally, there is growing apprehension over the potential toxicity of many shorter chain PFAS precursor compounds.

Traditional adsorbent methods do not provide a complete solution for PFAS. Adsorbent media, such as ion exchange resins and activated carbon, primarily target specific compounds such as PFOS, PFOA, and other long chain PFAS. Limitations of adsorbent media include an inability to capture short chain PFAS, high susceptibility to fouling when exposed to biology, blinding of the resin by many co-contaminants and the generation of relatively large volumes of spent media that requires landfill disposal at specialised facilities.

Olift™ offers a solution that produces clean treated water (>99.8%vol) and a PFAS concentrate (<0.2%vol). The concentrate is then sent for destruction, aligning with Ovivo's commitment to removing PFAS from the environment.

Olift™ and its patented advanced bubble technology has been developed and deployed for removing PFAS and other contaminants from the environment. We strive to produce high quality treated water streams with whole-of-project cost efficacy. We have achieved drinking water PFAS specifications from complex co-contaminated fluids, without pre-treatment.

TECHNOLOGY

The patented Olift™ process, marketed exclusively in North America by Ovivo, is a new generation technology that can be customized to meet the demands of the raw materials being treated. Olift™ utilizes micro-bubbles of ozone in a multiphase process that provides great versatility for the removal of contaminants and sediments via oxidation-reduction, precipitation, electrostatic flotation and if required reagent absorption, dependent upon the chemical group and species of interest.

Olift's vast gas-liquid interface elevates oxidation-reduction potential (ORP) conditions of the Olift™ chambers, degrading organic co-contaminants including petroleum hydrocarbons, and persistent contaminants as well as transforming metal ions into stable compounds and facilitating bubble adhesion for PFAS compounds. Degraded or stabilized byproducts are captured and removed via a number of industry established methods, providing a high-quality treated water. Collected contaminants can either be destroyed or disposed externally or where possible beneficially reused on site.

Olift™ ability to carry out several extractive techniques within a single reaction vessel provides significant advantages in reducing overall footprint and cost.

PROCESS

The multiple foam fractionation columns of an Olift™ plant remove greater than 99.5% of regulated PFAS from raw influents. This arrangement also reduces the total measured PFAS concentration by more than 85%, in the treated water.

The Olift™ process provides the following benefits:

- **Eliminates** down time from organic fouling due to its destructive treatment of almost all organic compounds.
- **Eliminates** process obstructions by removing suspended solids from the process fluid.
- **Reduces** the number of unit operations required for complex water contaminations by using the multifunction reaction chambers.
- **Reduces** waste volumes, which reduces on-site costs and external transport and disposal costs.
- **Recovers** resources, water and valuable minerals.
- **Reduces** reagent usage, by up to 75% in comparison to traditional methods. Reagents include adsorption media, if required for polishing to higher quality discharges.
- **Removes** contaminants from the environment eliminating risks to human health as well as other ecology.

APPLICATION

Olift™ can be installed either as a stand-alone process, an upstream bulk cleansing process for ultra-trace polishing processes or as a (pre- or post-) bolt-on to existing infrastructure. This versatility minimizes any potential disruptions to present operations. Olift™ plants are modular and can be scaled to meet any site requirements. Olift™ is designed to be energy efficient, while the energized process fluid, produced in the high oxidation-reduction environment, increases reagent efficiencies.




INTERNATIONAL AIRPORT — INDUSTRIAL SEWER 1, PFAS TREATMENT

CONTAMINANT	INFLUENT QUALITY	Olift™ TREATED	PERCENT VARIANCE	POST NF/RO POLISH	PERCENT VARIANCE
STANDARD PFAS ANALYSIS					
PFBS	0.09 µg/L	0.20 µg/L	-122.2%	0.03 µg/L	66.7%
PFPeS	0.06 µg/L	0.02 µg/L	66.7%	< 0.01 µg/L	83.3%
PFHxS	0.34 µg/L	< 0.01 µg/L	97.1%	< 0.01 µg/L	97.1%
PFHpS	0.06 µg/L	< 0.01 µg/L	83.3%	< 0.01 µg/L	83.3%
PFOS	1.83 µg/L	< 0.01 µg/L	99.5%	< 0.01 µg/L	99.5%
PFBA	0.45 µg/L	3.32 µg/L	-637.8%	0.66 µg/L	-46.7%
PFPeA	1.57 µg/L	8.40 µg/L	-435.0%	1.30 µg/L	17.2%
PFHxA	2.86 µg/L	13.73 µg/L	-380.1%	2.12 µg/L	25.9%
PFHpA	0.57 µg/L	0.37 µg/L	35.1%	0.04 µg/L	93.0%
PFOA	0.72 µg/L	< 0.01 µg/L	98.6%	< 0.01 µg/L	98.6%
PFNA	0.11 µg/L	< 0.01 µg/L	90.9%	< 0.01 µg/L	90.9%
6:2 FTS	19.78 µg/L	0.19 µg/L	99.0%	0.06 µg/L	99.7%
8:2 FTS	2.58 µg/L	< 0.02 µg/L	99.2%	0.03 µg/L	98.8%
Σ PFAS*	30.69 µg/L	26.44 µg/L	13.8%	0.45 µg/L	98.5%
Σ PFAS**	31.02 µg/L	26.30 µg/L	15.2%	4.30 µg/L	86.1%
TOTAL OXIDISED PFAS ASSAY (TOPA) ANALYSIS					
PFBS (TOPA)	4.06 µg/L	0.47 µg/L	88.4%	< 0.01 µg/L	99.8%
PFPeS (TOPA)	4.05 µg/L	0.03 µg/L	99.3%	< 0.01 µg/L	99.8%
PFHxS (TOPA)	4.24 µg/L	< 0.01 µg/L	99.8%	< 0.01 µg/L	99.8%
PFHpS (TOPA)	4.05 µg/L	< 0.01 µg/L	99.8%	< 0.01 µg/L	99.8%
PFOS (TOPA)	5.45 µg/L	< 0.01 µg/L	99.8%	< 0.01 µg/L	99.8%
PFBA (TOPA)	106.81 µg/L	9.19 µg/L	91.4%	0.06 µg/L	99.9%
PFPeA (TOPA)	230.23 µg/L	20.46 µg/L	91.1%	0.02 µg/L	99.99%
PFHxA (TOPA)	131.28 µg/L	34.61 µg/L	73.6%	0.05 µg/L	99.96%
PFHpA (TOPA)	23.01 µg/L	0.70 µg/L	97.0%	< 0.01 µg/L	99.96%
PFOA (TOPA)	11.30 µg/L	0.02 µg/L	99.8%	< 0.01 µg/L	99.9%
PFNA (TOPA)	4.64 µg/L	< 0.01 µg/L	99.8%	< 0.01 µg/L	99.8%
6:2 FTS (TOPA)	122.39 µg/L	0.39 µg/L	99.7%	0.03 µg/L	99.98%
8:2 FTS (TOPA)	18.72 µg/L	0.04 µg/L	99.8%	0.03 µg/L	99.8%
Σ PFAS (TOPA)*	631.08 µg/L	66.09 µg/L	89.5%	0.08 µg/L	99.99%
Σ PFAS (TOPA)**	670.23 µg/L	65.95 µg/L	90.2%	0.27 µg/L	99.96%

* Total as reported by laboratory. ** Total sum of reported individual PFAS results (calculated).

Reduction in PFAS Concentration via Olift™ and then NF/RO (TOP Assay PFAS Analysis) Log Scale Plot

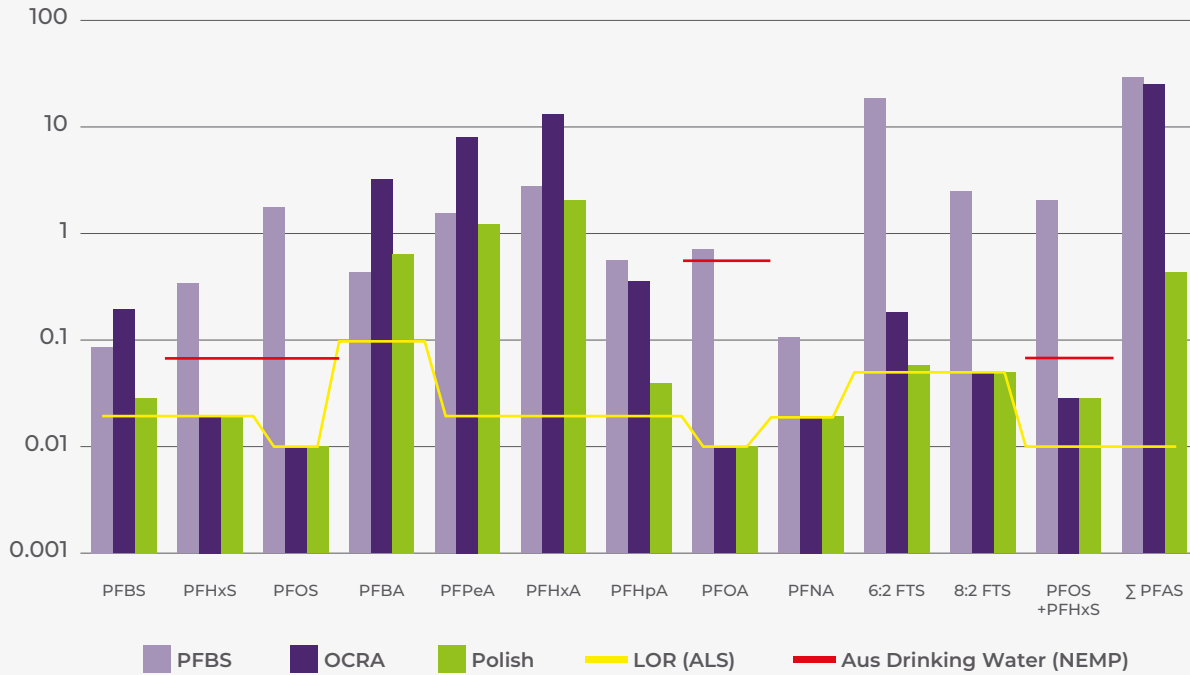

Reduction in PFAS Concentration via Olift™ and then NF/RO (Standard PFAS Analysis) Log Scale Plot

